

Air velocity and temperature transmitter

CTV 210-R


KEY POINTS

- Configurable ranges from 0 to 30 m/s with hot wire probe
- Configurable range from 0 to 50°C in temperature
- Airflow function
- Two 4-wire analogue output 0-5/10 V or 0/4-20 mA
- Power supply 24 Vdc/Vac or 100-240 Vac
- Trend indicator
- ABS V0 IP65 housing, with or without display
- "¼ turn" system mounting with wall-mount plate
- 2 relay outputs



FEATURES OF THE HOUSING

All dimensions are in millimeters.

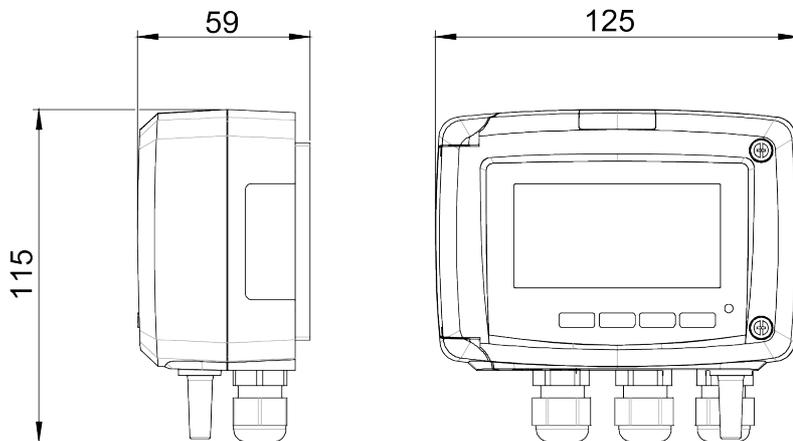

Material: ABS V0 as per UL94

Protection: IP65

Display: 75 x 40 mm, LCD 20 digits 2 lines.


Height of digits: Values: 10 mm; Units: 5 mm

Cable gland: For cables Ø8 mm maximum

Weight: 340 g

PART NUMBER

To order, just add the codes to complete the part number:

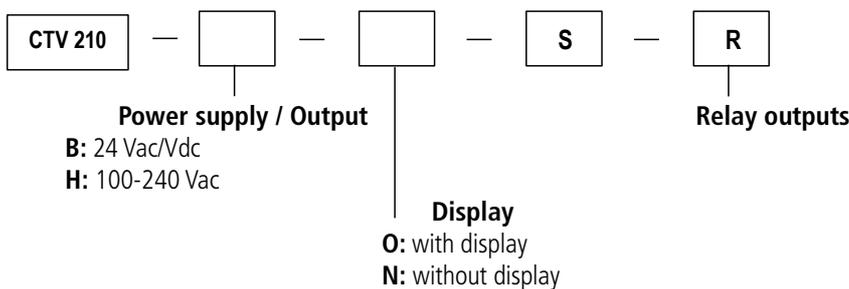

Example: CTV210 – BOS – R

Air velocity and temperature transmitter, power supply 24 Vac/Vdc, with display and relay outputs

TECHNICAL FEATURES IN TEMPERATURE

Measuring range	From 0 to +50°C
Unit of measurement	°C / °F
Accuracy*	±0.3% of reading ±0.25°C
Response time	$T_{90} = 0.9$ second for $V_{air} = 1$ m/s
Resolution	0.1°C / 0.1°F
Type of sensor	Pt100 1/3 as per DIN IEC751
Type of fluid	Air and neutral gases

TECHNICAL FEATURES IN AIR VELOCITY

Measuring range	Standard model: from 0 to 30 m/s
Unit of measurement	m/s, fpm, km/h
Accuracy*	From 0 to 3 m/s: ±3% of reading ±0.03 m/s From 3 to 30 m/s: ±3% of reading ±0.1 m/s
Resolution	Standard model: from 0 to 3 m/s: 0.01 m/s and from 3 to 30 m/s: 0.1 m/s
Response time	$T_{63} = 1.6$ s
Type of fluid	Clean air

*All the accuracies indicated in this technical datasheet were stated in laboratory conditions, and can be guaranteed for measurements carried out in the same conditions, or carried out with calibration compensation.

TECHNICAL FEATURES OF THE HOT WIRE PROBE

Material of the probe	Stainless steel 316 L
Size	Ø8 mm, length 300 mm
Operating temperature	From 0 to +50°C
Cable	PVC Ø4.8 mm, length 2 m



FUNCTION

Class 210 transmitters have two analogue outputs which correspond to the two parameters displayed. It is possible to activate one or two outputs and for each output, to select between air velocity, temperature and air flow.

<i>Function</i> \ <i>Features</i>	Measuring ranges	Units and resolutions
Air flow	From 0 to 99 999 dam ³ /h (according to air velocity and duct dimension)	1m ³ /h – 0.1 m ³ /s – 1 dam ³ /h 0.1l/s – 1 cfm

TECHNICAL SPECIFICATIONS

Power supply

24 Vac / Vdc ±10%
100-240 Vac, 50-60 Hz

Warning: risk of electric shock



Output

2 x 4-20 mA or 2 x 0-20 mA or 2 x 0-5 V or
2 x 0-10 V (4 wires)

Common mode voltage <30 Vac

Maximum load: 500 Ohms (0/4-20 mA)

Minimum load: 1 K Ohms (0-5/10 V)

2 changeover relays 3 A / 230 V

Galvanic isolation

Inputs and outputs (models 100-240 Vac)

Device fully protected by DOUBLE ISOLATION
or REINFORCED ISOLATION

Outputs (models 24 Vac/Vdc)



Consumption

CTV210-B: 6 VA

CTV210-H: 8 VA

European directives

2014/30/EU EMC; 2014/35/EU Low Voltage;
2011/65/EU RoHS II; 2012/19/EU WEEE

Electrical connection

Screw terminal block for cable 2.5 mm²

Carried out according to the code of good
practice

PC communication

USB-Mini Din cable

Environment

Air and neutral gases

Type of fluid

Air and neutral gases

Conditions of use (°C/%RH/m)

From -10 to +50°C. In non-condensing
condition. From 0 to 2000 m.

Storage temperature


From -10 to +70°C

Security

Protection class II; Pollution degree 2;

Overvoltage category 2 (OVCI)

CONNECTIONS

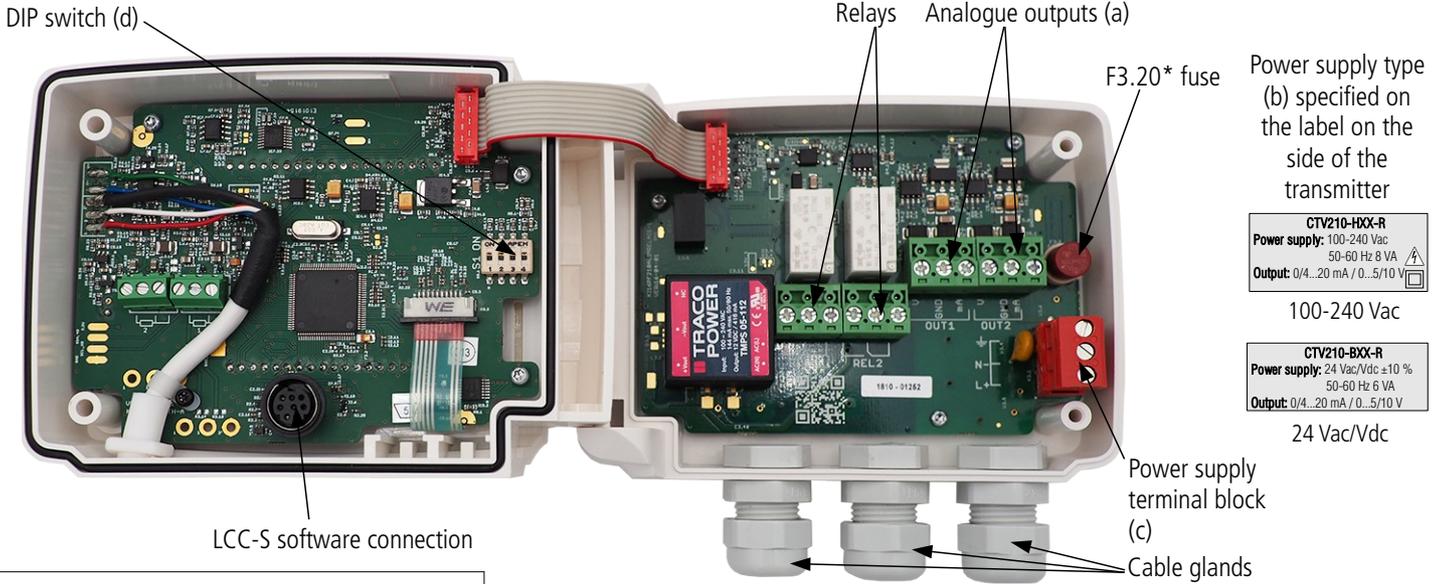






Power supply type (b) specified on the label on the side of the transmitter

CTV210-HXX-R
 Power supply: 100-240 Vac
 50-60 Hz 6 VA
 Output: 0/4...20 mA / 0...5/10 V

100-240 Vac

CTV210-BXX-R
 Power supply: 24 Vac/Vdc ±10 %
 50-60 Hz 6 VA
 Output: 0/4...20 mA / 0...5/10 V





24 Vac/Vdc

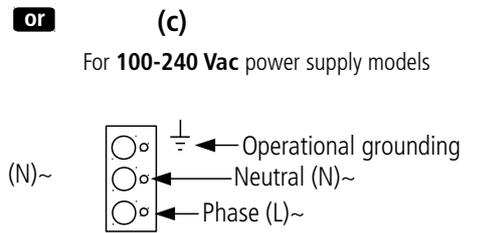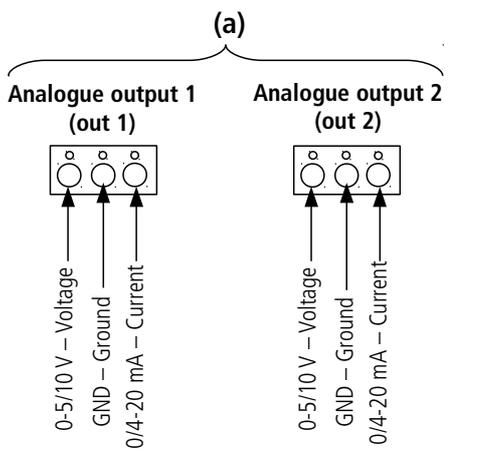

* Fuse present only for 100-240 Vac models.
 Every fuse replacement must be performed with a power off device using a TR5 630 mA 250 V fuse.

ELECTRICAL CONNECTIONS – as per NFC15-100 standard

Warning: This connection must be made by a formed and qualified technician. To make the connection, the transmitter must not be energized. Before making the connection, you must first check the power supply indicated on the transmitter board (see (b) on "Connections" part). The presence of a switch and a circuit breaker upstream the device is compulsory

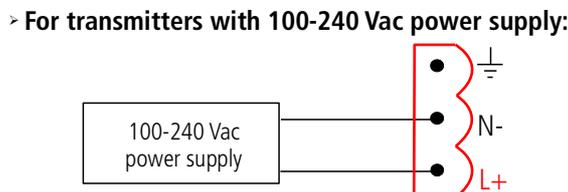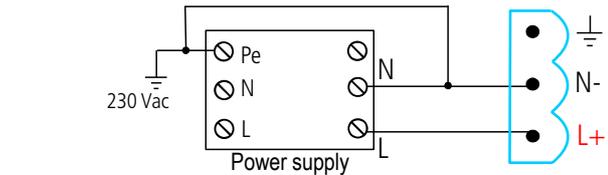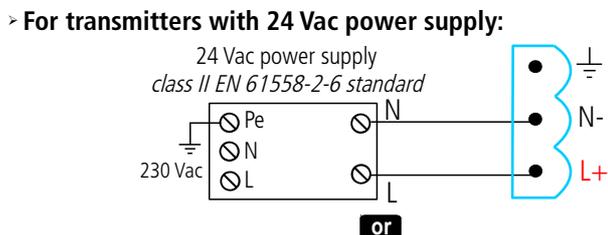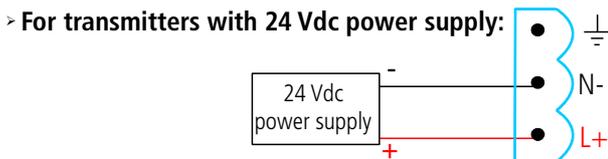


Warning: On 100-240 Vac models, if a fuse protection is used for the power line, it is imperative to use delayed-action fuses in order to absorb the surge of current when first turned on the transmitter.


The selection of the output signal in voltage (0-10 V or 0-5 V) or in current (4-20 mA or 0-20 mA) is made via the DIP switch (d) of the electronic board of the transmitter: put the on-of switches as shown in the table below:

Configurations	4-20 mA	0-10 V	0-5 V	0-20 mA
Combinations				

> Connection of the output in current 4-20 mA:

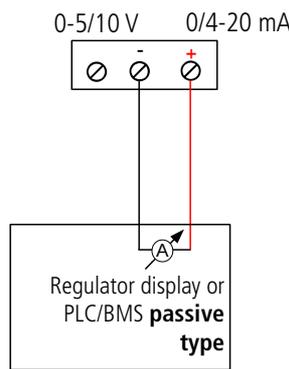

> Connection of output in voltage 0-10 V:

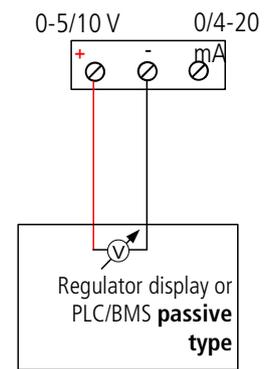

4-20 mA output

0-10 V output

CONFIGURATION OF THE TRANSMITTERS

It is possible on the class 210 to configure all the parameters of the transmitter: units, measuring ranges, outputs, channels, calculation functions, etc, via different methods:

- **Via keypad** for models with display: a code-locking system allows to secure the installation (See class 210 transmitters user manual).
- **Via software** (optional) on all models. Simple user-friendly configuration. See LCC-S user manual.

Configurable analogue output:

It is possible to configure your own intermediary ranges (minimum range: from 0 to 1 m/s).


Configure the range according to your needs: outputs are automatically adjusted to the new measuring range



MOUNTING

To mount the transmitter, mount the ABS plate on the wall (drilling: $\varnothing 6$ mm, screws and pins are supplied).

Insert the transmitter on the fixing plate (see A on the drawing beside). Rotate the housing in clockwise direction until you hear a "click" which confirms that the transmitter is correctly installed.

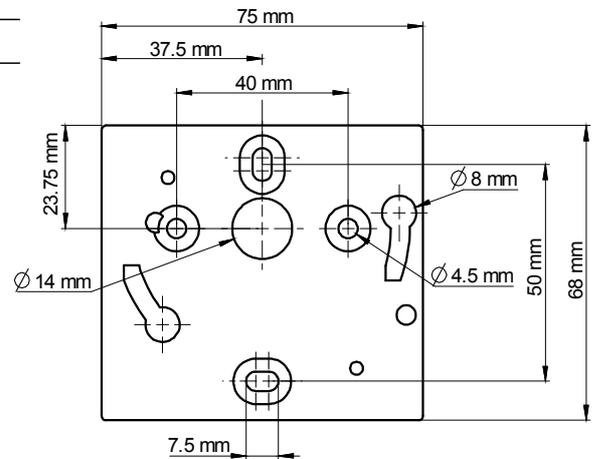

CALIBRATION

Outputs diagnostic: With this function, you can check with a multimeter (or on a regulator / display, or a PLC / BMS) if the transmitter outputs work properly. The transmitter generates a voltage of 0 V, 5 V and 10 V or a current of 4 mA, 12 mA and 20 mA

Certificate: Class 210 transmitters are supplied with adjusting certificates. Calibration certificates are available as option.

MAINTENANCE

Please avoid any aggressive solvent. Please protect the transmitter and its probes from any cleaning product containing formalin, that may be used for cleaning rooms or ducts.

OPTIONS AND ACCESSORIES

- **LCC-S:** configuration software with USB cable
- **Calibration certificate**
- Sliding fittings
- Mounting brackets
- Clean spray for hotwire probe



Only the accessories supplied with the device must be used.

PRECAUTIONS FOR USE

Please always use the device in accordance with its intended use and within parameters described in the technical features in order not to compromise the protection ensured by the device.



Once returned to KIMO, required waste collection will be assured in the respect of the environment in accordance with European guidelines relating to WEEE.



Export Department
Tel.: +33 (0)1 60 06 69 25
Fax: +33 (0)1 60 06 69 29
Email: export@kimo.fr

www.kimo.fr

Distributed by: